


Amps X 1000 STATION SERV. SUBSTATION (Nom. kV=0.48, Plot Ref. kV=0.48)

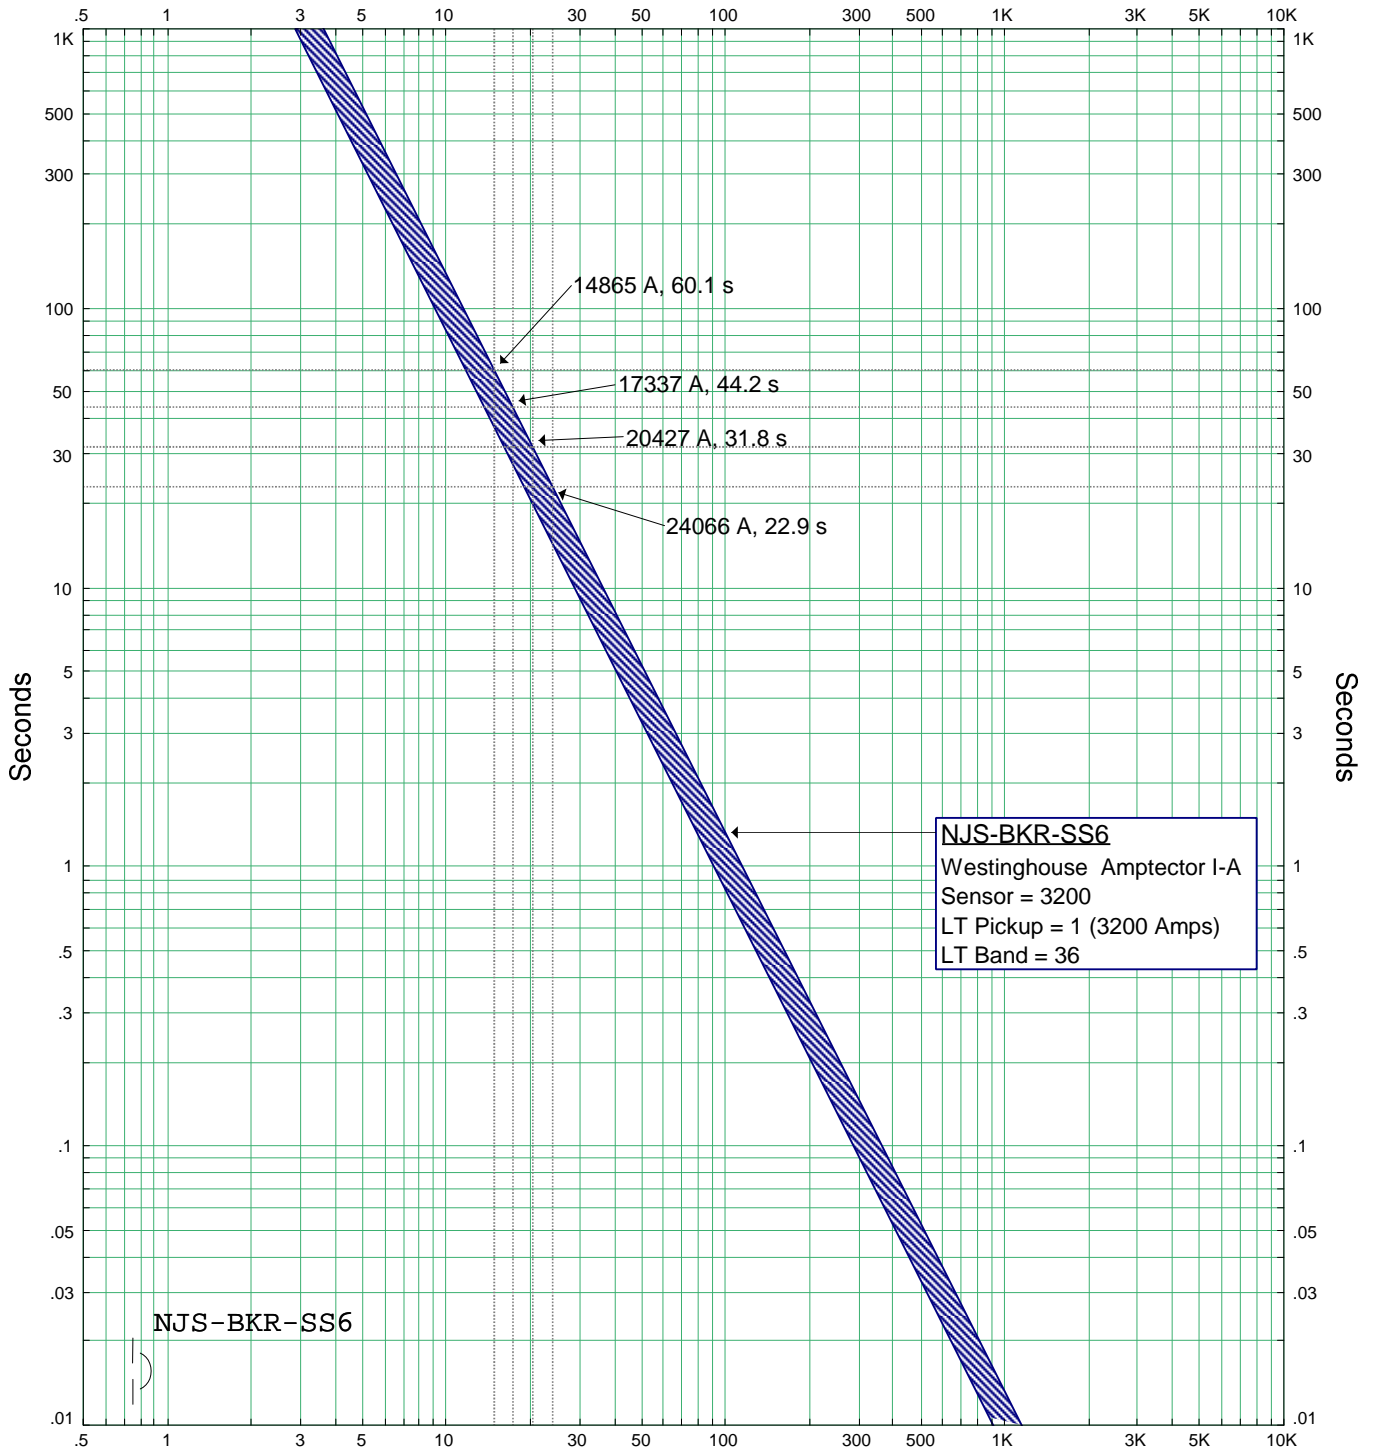

Amps X 1000 STATION SERV. SUBSTATION (Nom. kV=0.48, Plot Ref. kV=0.48)

ETAP Star 7.5.0C

	SS6	
<p>Project: TECO Arc Flash Hazard Study Location: Phillips Station Contract: T08105 Engineer: PegasusTSI Filename: C:\Documents and Settings\lawthb\My Documents\ETAP\New Folder\Sebring.</p>		<p>Date: 01-12-2011 SN: TAMPA-ELEC Rev: Base Fault: Phase</p>