


Amps X 1000 STATION SERV. SUBSTATION (Nom. kV=0.48, Plot Ref. kV=0.48)

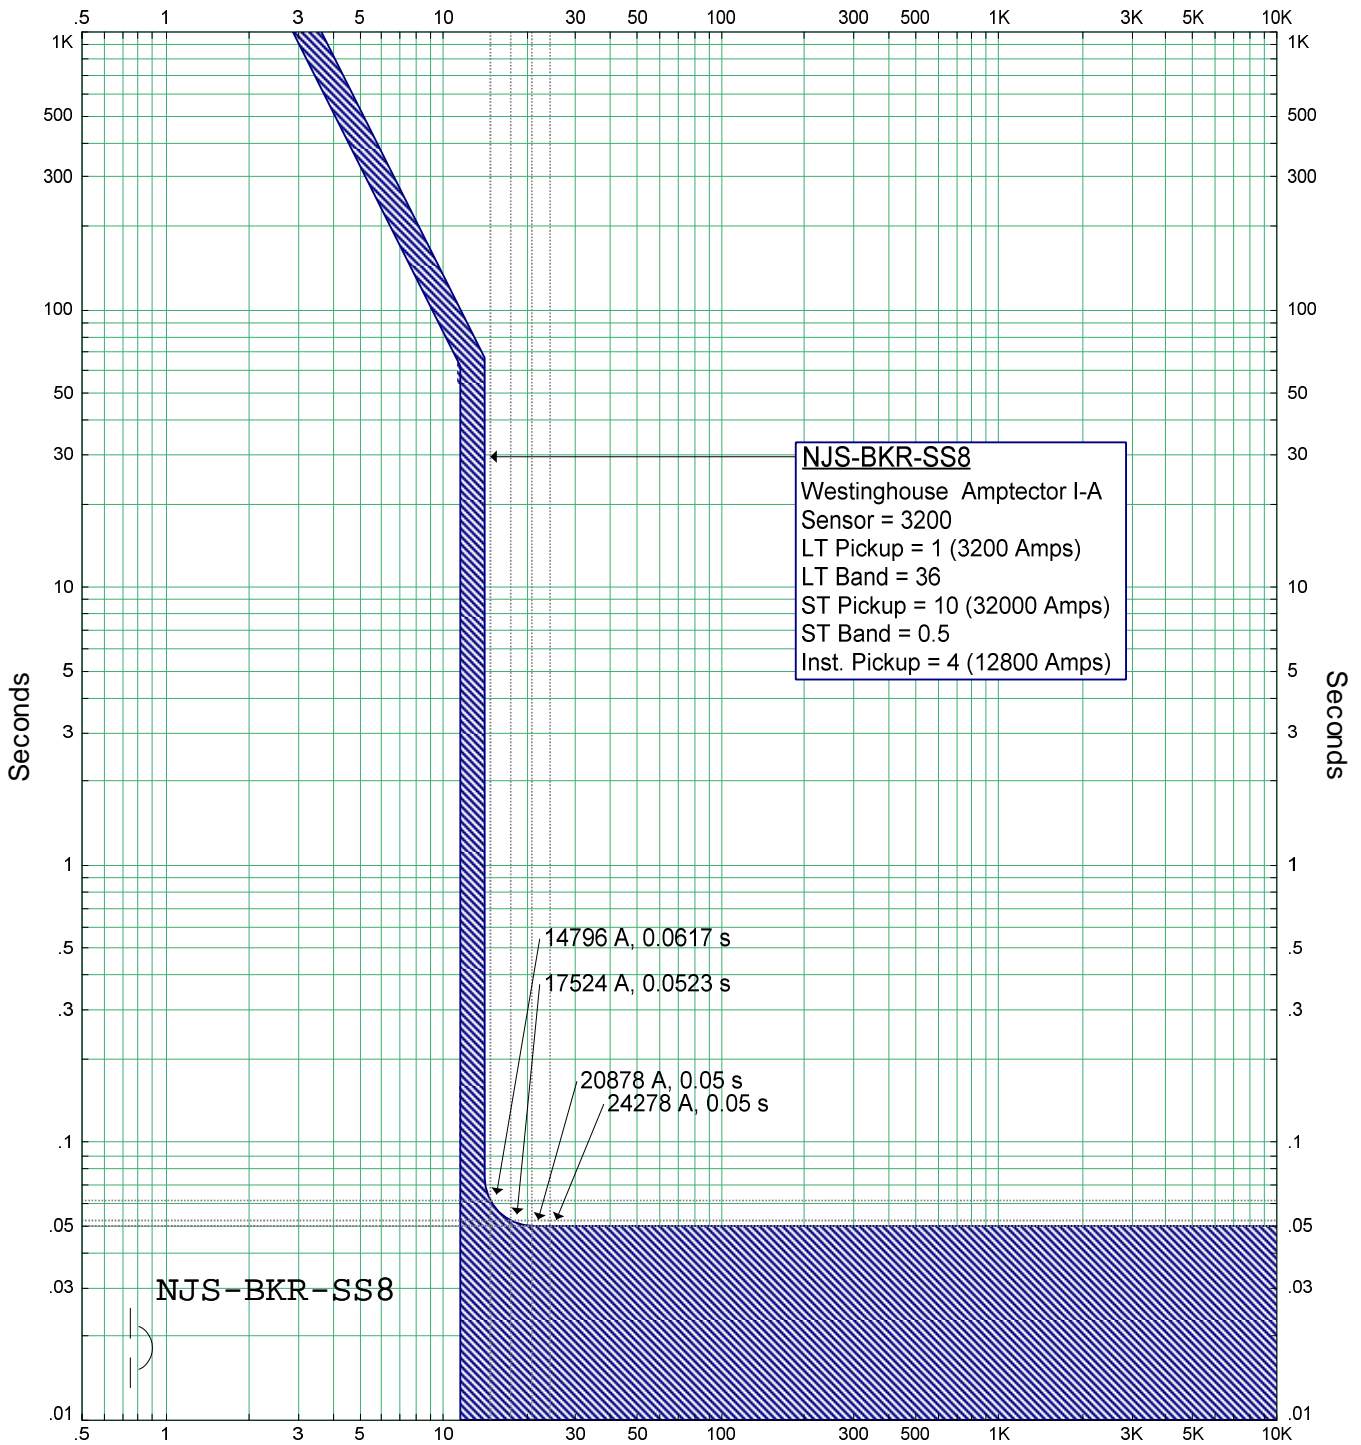

Amps X 1000 STATION SERV. SUBSTATION (Nom. kV=0.48, Plot Ref. kV=0.48)

ETAP Star 7.5.0C

**SS8**

Project: TECO Arc Flash Hazard Study  
 Location: Phillips Station  
 Contract: T08105  
 Engineer: PegasusTSI  
 Filename: C:\Documents and Settings\lawthb\My Documents\ETAP\New Folder\Sebring.

Date: 01-12-2011  
 SN: TAMPA-ELEC  
 Rev: Base  
 Fault: Phase